




Turbo Cool

Distribution Pipe End Fitting Update

The PVC fittings used at the two ends of the Distribution Pipe in the Chore-Time Turbo Cool System have been changed. Install the fittings as shown below

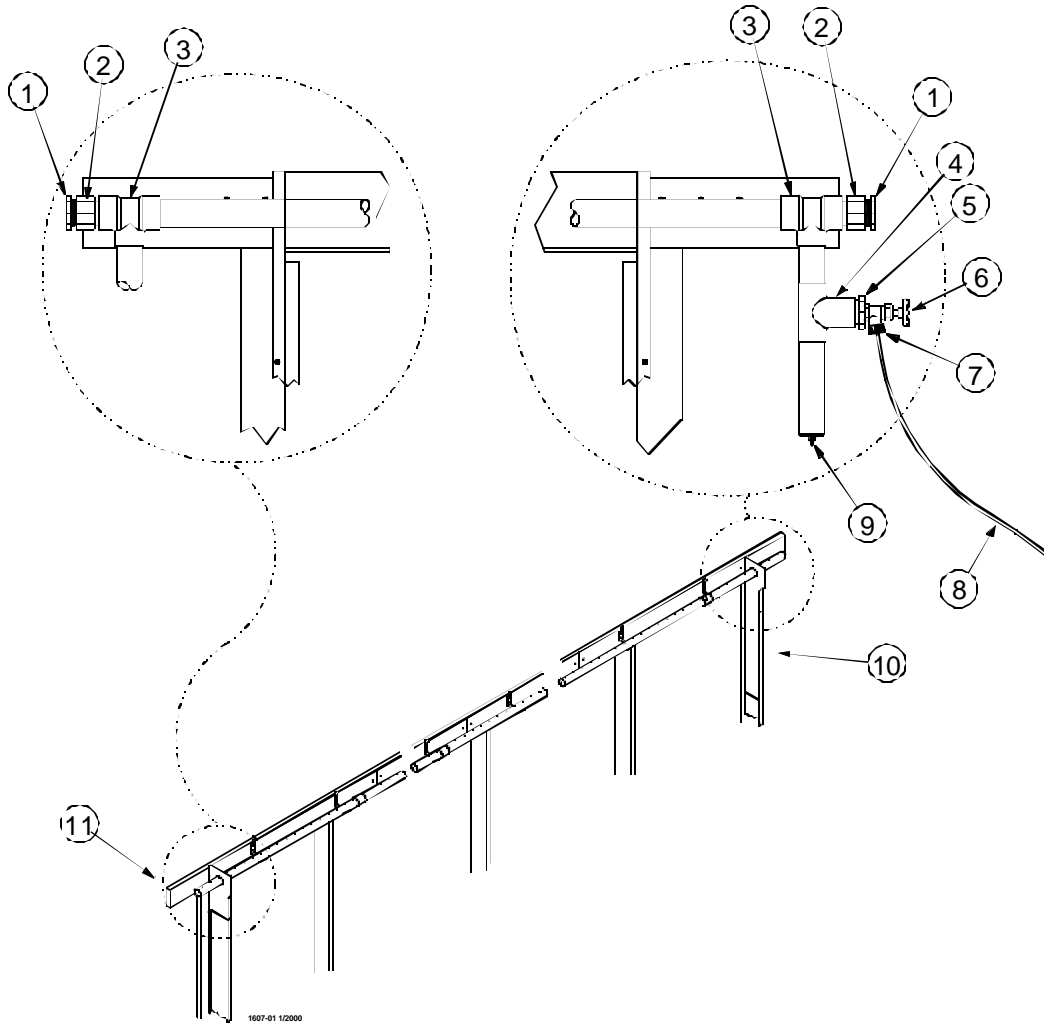

Item	Description	Part No.	Qty
1	2" PVC Threaded Pipe Plug	45749	2
2	2" PVC Adapter (slip to female pipe thread)	45748	2
3	2" x 1-1/2" PVC Tee	41427	2
4	1-1/2" PVC Tee	38618	1
5	1-1/2" x 3/4" PVC Bushing (slip to female pipe thread)	38672	1
6	3/4" Bleed-Off Valve	9255	1
7	Hose Barb Cap	24111	1
8	1/4" Black Bleed-Off Hose	14454-144	1
9	1-1/2" Drain Plug	38476	1
10	Inlet End	—	—
11	Sump End	—	—

Chore-Time Equipment a Division of CTB Inc.
 P.O. Box 2000 • Milford, Indiana 46542-2000 • U.S.A.
 Phone (219) 658-4101 • Fax (800) 333-4191
 E-Mail: ctb@ctbinc.com • Internet: <http://www.ctbinc.com>